



Monthly Report

District Activity

AUGUST 2014

SIGNIFICANT INCIDENTS:

August 11, 2014 Full Still –Automatic Fire Alarm: Units responded for a fire alarm. On arrival found light smoke on first floor. Investigated to find small fire in men’s restroom under vanity top contained by sprinkler head. Damage limited to vanity top and water damage from sprinkler. Approximate \$50,000 loss.

August 18, 2014 Full Still –Inside Smoke Investigation: Units responded for report of smoke in a neighboring apartment from caller. On arrival alarm was upgraded to a General Alarm as personnel found a fire in a third floor apartment. Entry was made to find a small fire in the living room contained by the sprinkler system and remainder of fire put out by pump can. Fire damage confined to one unit, water damage on several floors. Approximate \$160,000 loss.

INCIDENT RESPONSE INFORMATION

Month - 562

Year to date - 4395

Last year:

Month - 504

PROPERTY / CONTENTS LOSS INFORMATION

Month: \$191,500

Year to date: \$1,282,474

Contents Loss Information

Month: \$90,000.00




Monthly Report

AUGUST 2014


DESCRIPTION	COUNT	DESCRIPTION	COUNT
Household appliance fire contained	1	Assist police or other governmental agency	1
Building fire	6	Assist invalid	6
Cooking fire, confined to container	1	Defective elevator, no occupants	2
Passenger vehicle fire	2	Cover assignment, standby, moveup	1
Road freight or transport vehicle fire	1	Good intent call, Other	6
Outside rubbish, trash or waste fire	2	Dispatched & cancelled en route	19
EMS call, excluding vehicle accident with injury	333	No Incident found on arrival at dispatch address	1
MEDICAL ALERT ALARM	5	Authorized controlled burning	1
Motor vehicle accident with injuries	20	Smoke scare, odor of smoke	1
Motor Vehicle Accident with no injuries	8	Central station, malicious false alarm	1
Extrication of victim(s) from vehicle	1	System malfunction, Other	2
Removal of victim(s) from stalled elevator	4	Smoke detector activation due to malfunction	2
Rescue or EMS standby	6	Alarm system sounded due to malfunction	51
Gasoline or other flammable liquid spill	2	CO detector activation due to malfunction	3
Gas leak (natural gas or LPG)	5	CO detector activation due to out of date/old unit	2
Carbon monoxide incident	1	Detector activation, no fire - unintentional	1
Power line down	2	Alarm system activation, no fire - unintentional	53
Arcing, shorted electrical equipment	3	Carbon monoxide detector activation, no CO	1
Lock-out	4	Lightning strike (no fire)	1

AUGUST 2014


INCIDENTS BY DISTRICT

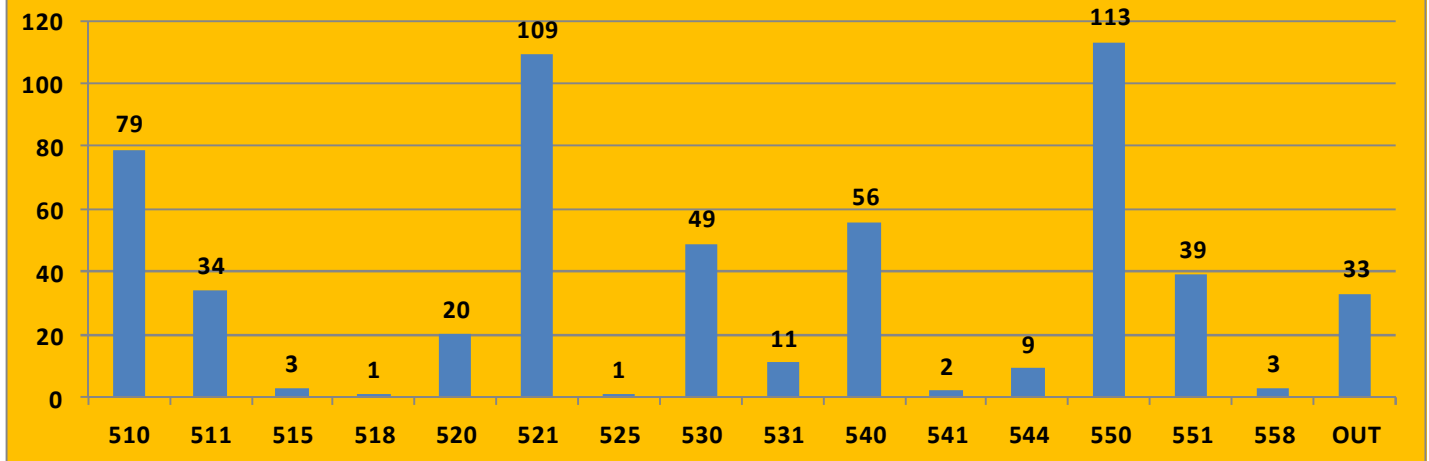

RESPONSES BY UNIT

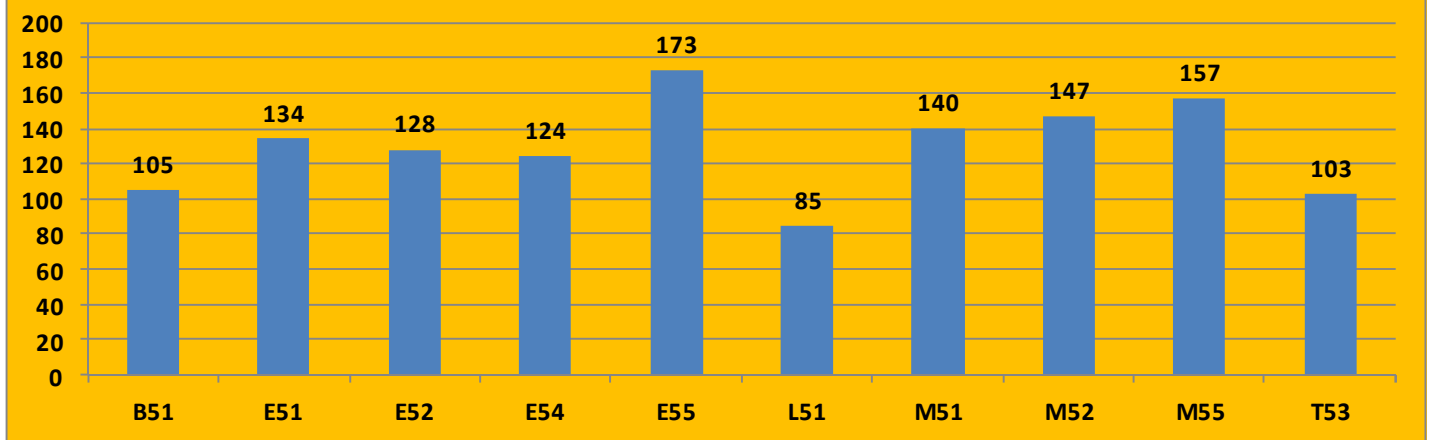

TYPE OF ALARM

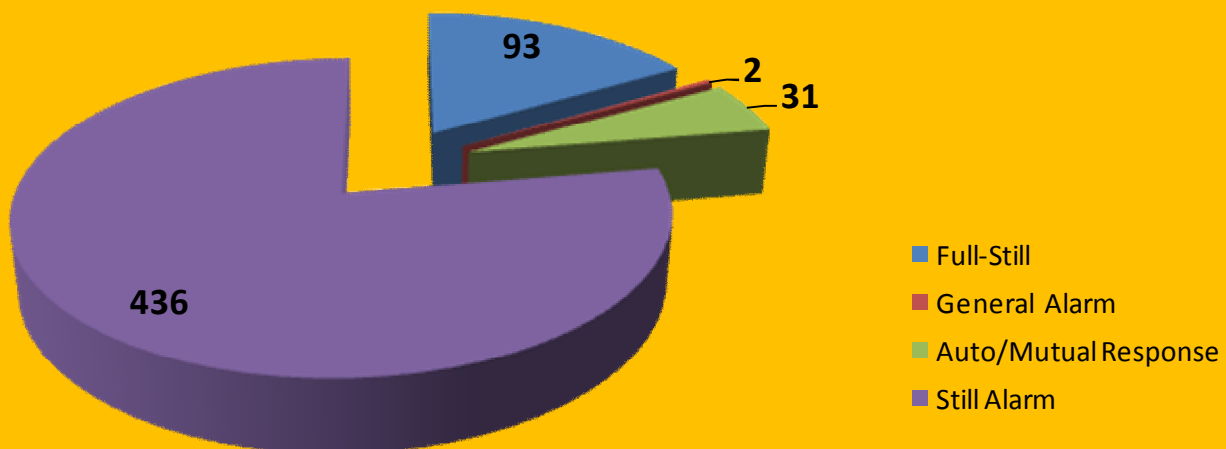

AUGUST 2014

