



Monthly Report

District Activity

DECEMBER 2013

Significant Incidents:

December 3, 2013

Structure Fire—24W700 Ohio Street, unincorporated Naperville

Full Still units dispatched for a smoke investigation. The first unit on the scene reported an odor of something burning, then quickly upgraded to a General Alarm after smoke became visible. Fire was determined to be in a completely finished lookout basement with only access from the interior. Conditions rapidly changed with portions of the first floor collapsing and retreating. Incident upgraded to a Box Alarm. Fire ran up through a void into the attic. Elevated streams were deployed and the Box Alarm was upgraded to a 2-11 alarm. A high expansion foam unit from Lyons Fire Department was utilized to extinguish hidden spots in the basement. Three firefighter injuries reported.

INCIDENT RESPONSE INFORMATION

Month - 582

Year to date - 6399

Last year:

Month - 513

Year to date - 5827

PROPERTY / CONTENTS LOSS INFORMATION

Month: \$418,000

Year to date: \$1,583,750

Contents Loss Information

Month: \$86,800.00

Year to date: \$348,950.00



Monthly Report


DECEMBER 2013

INCIDENTS BY TYPE


| Description | Incidents | | |
|--|-----------|--|----|
| | | Assist invalid | 16 |
| Household appliance fire contained | 3 | Defective elevator, no occupants | 2 |
| Building fire | 5 | Unauthorized burning | 1 |
| Trash or rubbish fire, contained | 1 | Cover assignment, standby, moveup | 8 |
| Passenger vehicle fire | 4 | Good intent call, Other | 7 |
| Dumpster or other outside trash receptacle fire | 1 | Dispatched & cancelled en route | 12 |
| Excessive heat, scorch burns with no ignition | 1 | Authorized controlled burning | 1 |
| EMS call, excluding vehicle accident with injury | 319 | Smoke scare, odor of smoke | 5 |
| MEDICAL ALERT ALARM | 4 | Steam, vapor, fog or dust thought to be smoke | 2 |
| Motor vehicle accident with injuries | 30 | Central station, malicious false alarm | 3 |
| Motor Vehicle Accident with no injuries | 3 | System malfunction, Other | 2 |
| Lock-in (if lock out , use 511) | 1 | Sprinkler activation due to malfunction | 4 |
| Removal of victim(s) from stalled elevator | 1 | Smoke detector activation due to malfunction | 3 |
| Water & ice-related rescue, other | 1 | Alarm system sounded due to malfunction | 31 |
| Rescue or EMS standby | 1 | CO detector activation due to malfunction | 8 |
| CARBON DIOXIDE LEAK | 1 | CO detector activation due to bad battery | 1 |
| Gasoline or other flammable liquid spill | 2 | CO detector activation due to out of date/old unit | 2 |
| Gas leak (natural gas or LPG) | 14 | Sprinkler activation, no fire - unintentional | 3 |
| Carbon monoxide incident | 8 | Smoke detector activation, no fire - unintentional | 8 |
| Electrical wiring/equipment problem, Other | 1 | Detector activation, no fire - unintentional | 2 |
| Overheated motor | 2 | Alarm system activation, no fire - unintentional | 40 |
| Power line down | 3 | Carbon monoxide detector activation, no CO | 7 |
| Arcing, shorted electrical equipment | 2 | | |
| Lock-out | 3 | | |
| Water problem, Other | 1 | | |
| Water or steam leak | 1 | | |
| Smoke or odor removal | 1 | | |

DECEMBER 2013


INCIDENTS BY DISTRICT

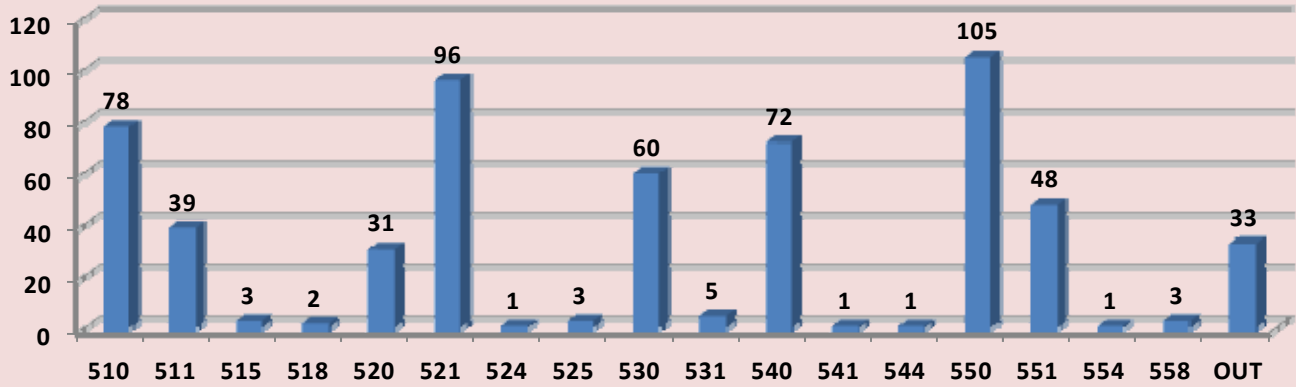

RESPONSES BY UNIT

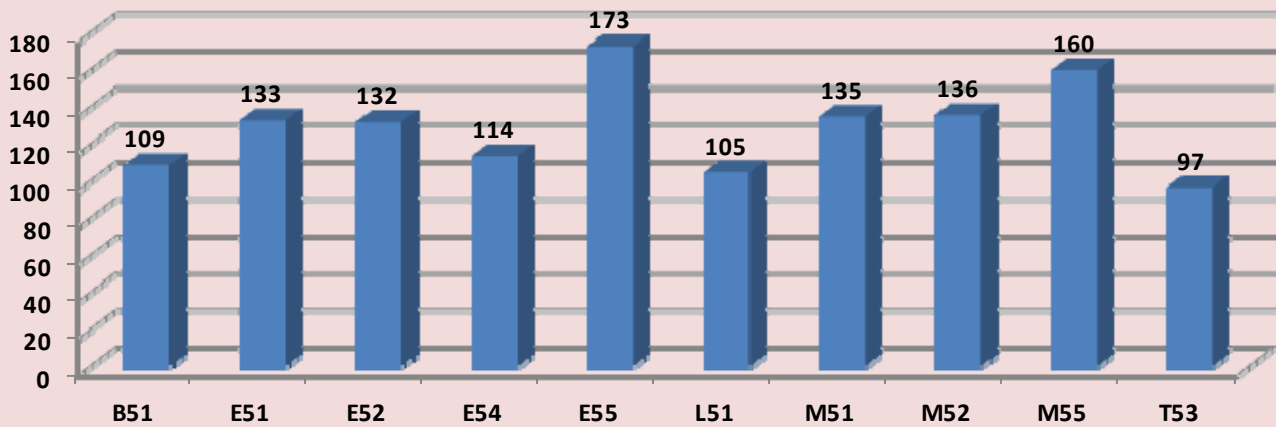


TYPE OF ALARM REPORT

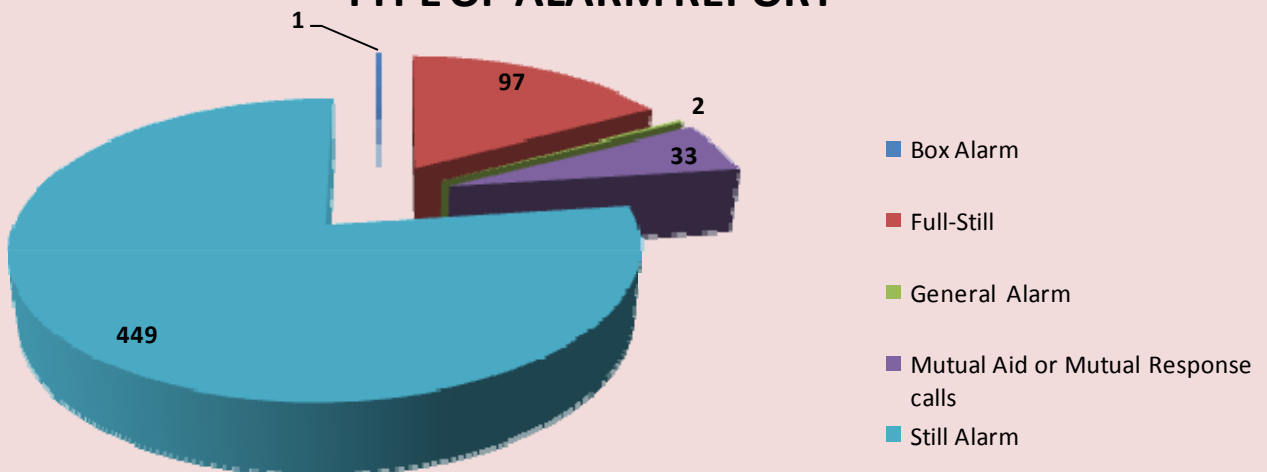


DECEMBER 2013

HOURS BY TYPE OF LEAVE

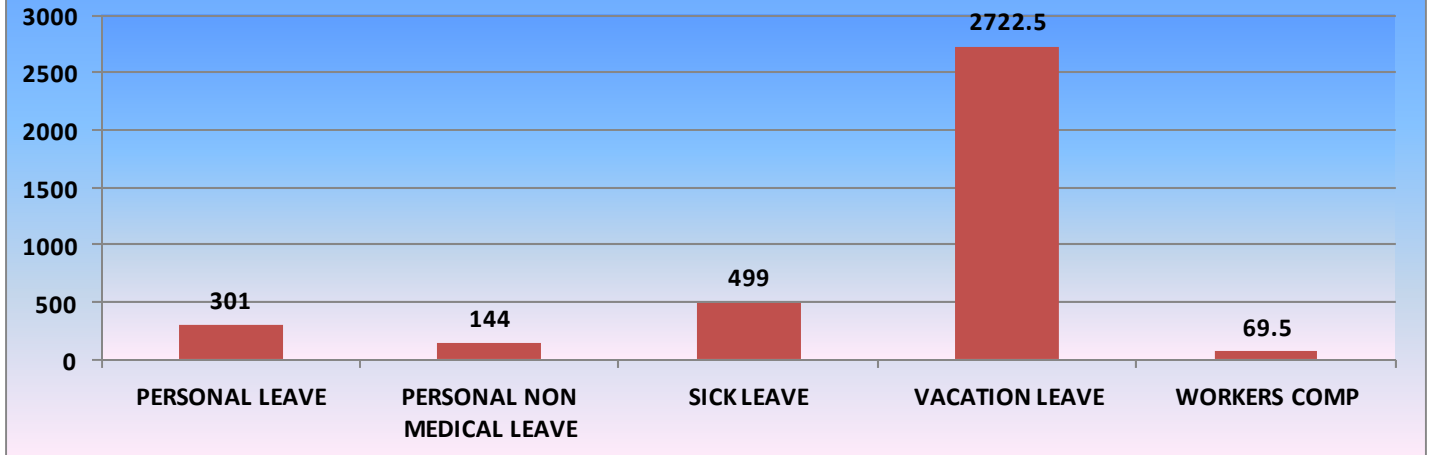

OUT OF RANK HOURS BY RANK

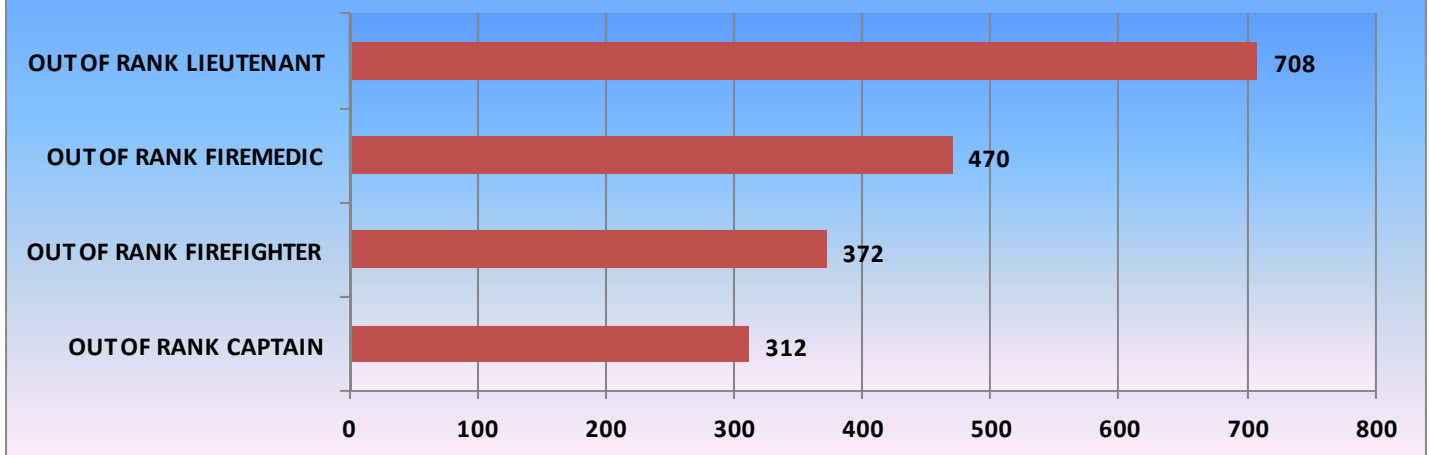

OVERTIME AND PART TIME HOURS

