



Monthly Report

District Activity

JANUARY 2015

SIGNIFICANT INCIDENTS:

January 11th—Structure Fire: 4459 Hatch Lane, Lisle

Units were initially dispatched for a dryer fire not extended. First unit on the scene reported smoke showing from the single family residence and upgraded the alarm. Fire broke through several windows and began burning upwards on the cedar siding. Main body of fire contained in laundry room with significant smoke and heat damage throughout the house. Notification of the fire was delayed by occupant making several attempts to extinguish the fire prior to calling 911. Approximate total damages exceed \$250,000. One firefighter injury, no civilian injuries.

INCIDENT RESPONSE INFORMATION

Month - 561

Year to date - 561

Last year:

Month - 662

Year to date - 662

PROPERTY LOSS INFORMATION

Month: \$201,600

Year to date: \$201,600

Contents Loss Information

Month: \$76,500

Year to date: \$76,500




Monthly Report

JANUARY 2015


DESCRIPTION	# Incidents	DESCRIPTION	# Incidents
Household appliance fire contained	1	Assist police or other governmental agency	1
Building fire	7	Assist invalid	24
Cooking fire, confined to container	1	Defective elevator, no occupants	1
Outside rubbish, trash or waste fire	1	Cover assignment, standby, moveup	2
Dumpster or other outside trash receptacle fire	2	Good intent call, Other	10
Excessive heat, scorch burns with no ignition	1	Good intent call-Gas Odor Unfounded	1
EMS call, excluding vehicle accident with injury	312	Dispatched & cancelled en route	14
MEDICAL ALERT ALARM	8	No Incident found on arrival at dispatch address	1
Motor vehicle accident with injuries	29	Smoke scare, odor of smoke	10
Motor vehicle/pedestrian accident (MV Ped)	1	Steam, vapor, fog or dust thought to be smoke	1
Motor Vehicle Accident with no injuries	4	Central station, malicious false alarm	3
Lock-in (if lock out , use 511)	1	System malfunction, Other	2
Removal of victim(s) from stalled elevator	3	Smoke detector activation due to malfunction	1
Ice rescue	1	Smoke detector activation due to battery issue	1
Gas leak (natural gas or LPG)	4	Alarm system sounded due to malfunction	21
Oil or other combustible liquid spill	1	CO detector activation due to malfunction	4
Carbon monoxide incident	6	CO detector activation due to bad battery	4
Light Pole / Traffic Signal Pole Down	1	CO detector activation due to out of date/old unit	5
Arcing, shorted electrical equipment	2	Sprinkler activation, no fire - unintentional	3
Lock-out	6	Smoke detector activation, no fire - unintentional	3
Water or steam leak	7	Alarm system activation, no fire - unintentional	46
		Carbon monoxide detector activation, no CO	4

JANUARY 2015


INCIDENTS BY DISTRICT

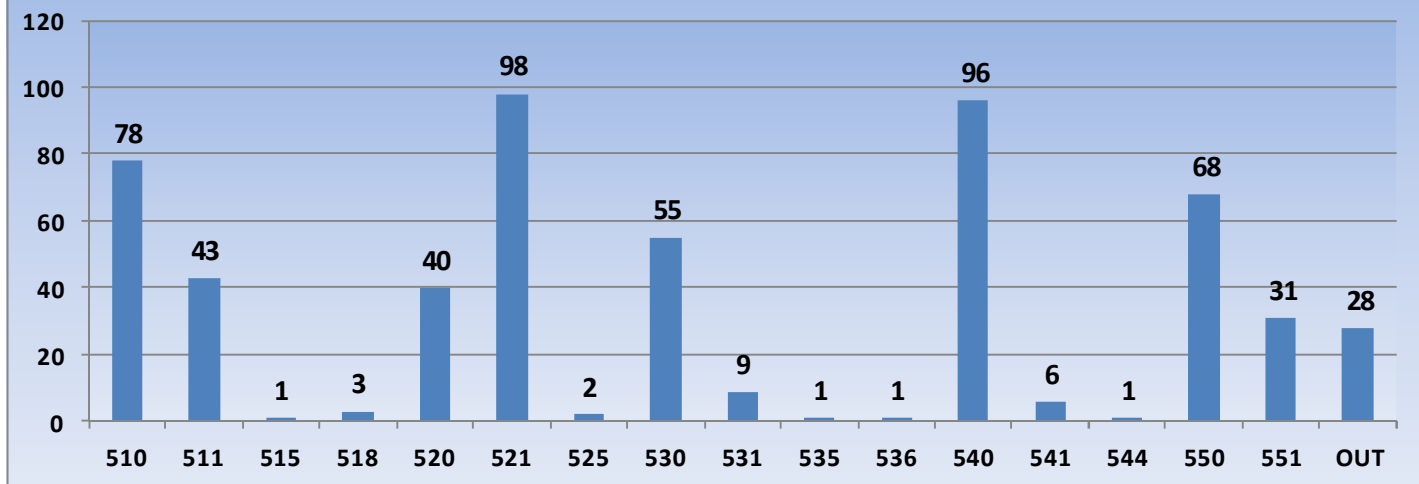

RESPONSES BY UNIT

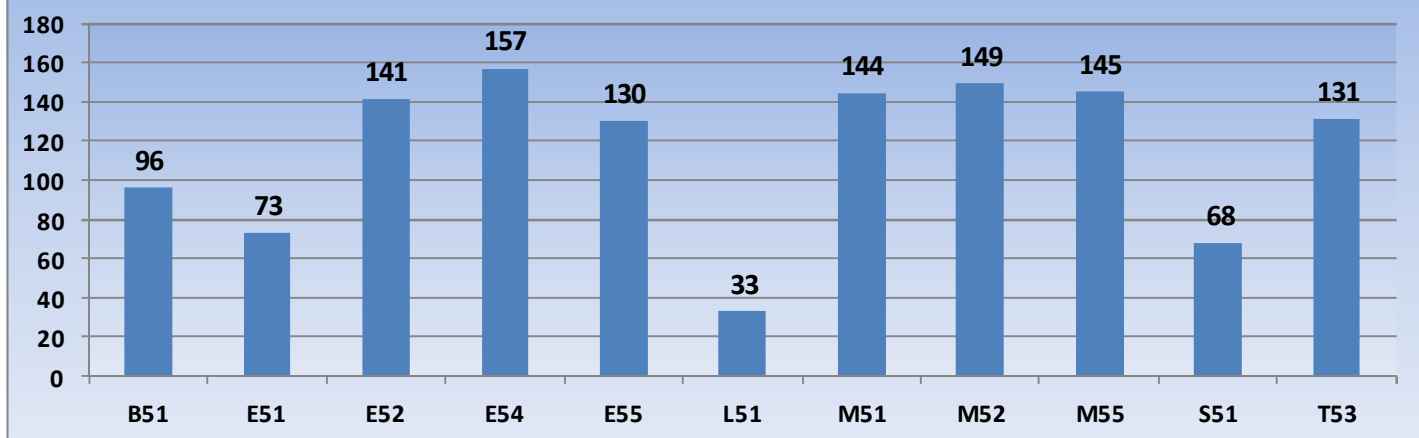

TYPE OF ALARM

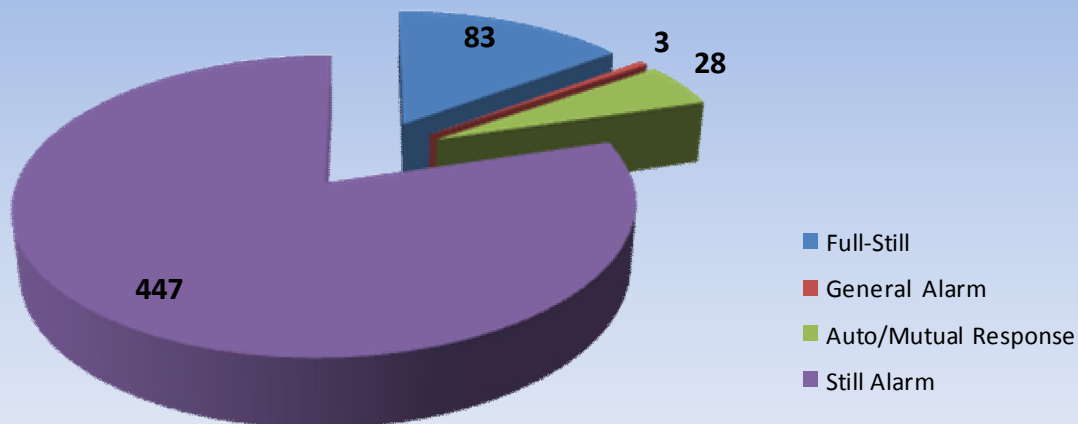

JANUARY 2015

