



Monthly Report

District Activity

MAY 2014

SUBSTANTIAL INCIDENTS:

May 26, 2014 at 0211 hours — General Alarm 2628 York Court, Woodridge

Units initially dispatched to a full still for an electrical investigation. While enroute units were advised police on the scene reporting fire through the roof and the alarm was upgraded to a General Alarm. Arriving units found an attic fire with visible flames showing. Woodridge police officers reported one occupant remaining in the home. Personnel found a police officer attempting to evacuate an elderly subject from the upper level of the home. The subject was successfully removed and sent to a medic unit for evaluation but did not require treatment or transport. Companies made their way to the upper level with a hand line, pulled ceiling and quickly extinguished the fire at the same time personnel were opening the roof. One minor firefighter injury that required medical attention was reported. Approximately \$95,000 in property and contents loss.

INCIDENT RESPONSE INFORMATION

Month - 537

Year to date - 2753

Last year:

Month - 509

Year to date - 2661

PROPERTY / CONTENTS LOSS INFORMATION

Month: \$80,200

Year to date: \$324,974

Contents Loss Information

Month: \$15,000

Year to date: \$95,500



Monthly Report


Page 2
District Activity

MAY 2014


DESCRIPTION	# INCIDENTS
Household appliance fire contained	1
Building fire	10
Cooking fire, confined to container	2
Passenger vehicle fire	1
Outside rubbish, trash or waste fire	1
Dumpster or other outside trash receptacle fire	1
Outside equipment fire	1
Excessive heat, scorch burns with no ignition	1
EMS call, excluding vehicle accident with injury	287
MEDICAL ALERT ALARM	16
Motor vehicle accident with injuries	25
Motor vehicle/pedestrian accident (MV Ped)	1
Motor Vehicle Accident with no injuries	4
Extrication, rescue, Other	1
Confined space rescue	1
Water & ice-related rescue, other	1
Rescue or EMS standby	2
Gasoline or other flammable liquid spill	2
Gas leak (natural gas or LPG)	2
Carbon monoxide incident	1
Arcing, shorted electrical equipment	7
Building or structure weakened or collapsed	1
Lock-out	2
Water problem, Other	1
BASEMENT/ BUILDING FLOODING	1
Water or steam leak	1
Assist invalid	32
Defective elevator, no occupants	1
Cover assignment, CHANGE OF QUARTERS	6
Good intent call, Other	8
Dispatched & cancelled en route	14
Authorized controlled burning	1
Smoke scare, odor of smoke	7
Central station, malicious false alarm	2
System malfunction, Other	4
Smoke detector activation due to malfunction	1
Alarm system sounded due to malfunction	19
CO detector activation due to out of date/old unit	2
Smoke detector activation, no fire - unintentional	1
Detector activation, no fire - unintentional	2
Alarm system activation, no fire - unintentional	62
Carbon monoxide detector activation, no CO	1

MAY 2014


INCIDENTS BY DISTRICT

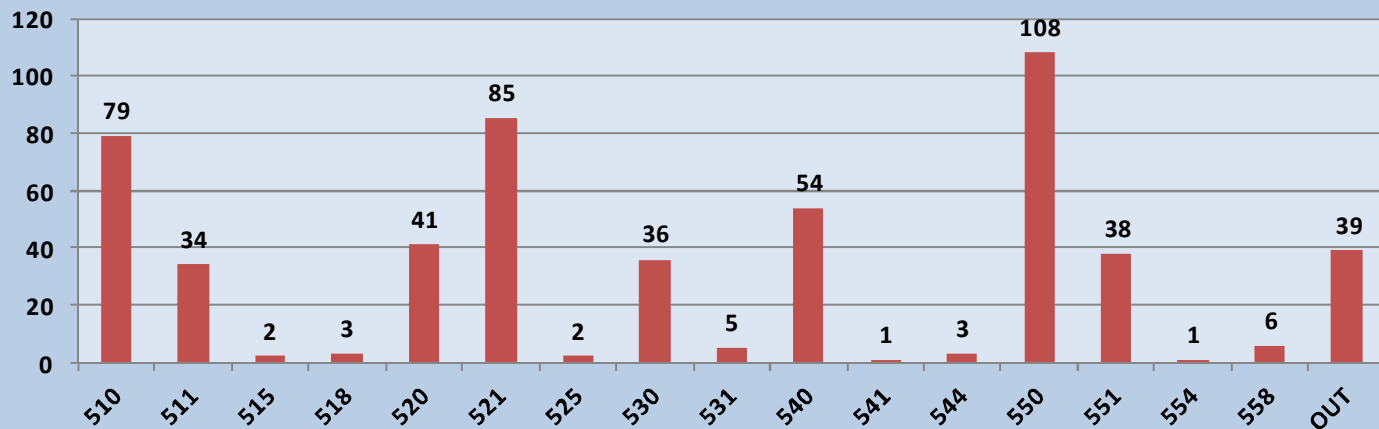

RESPONSES BY UNIT

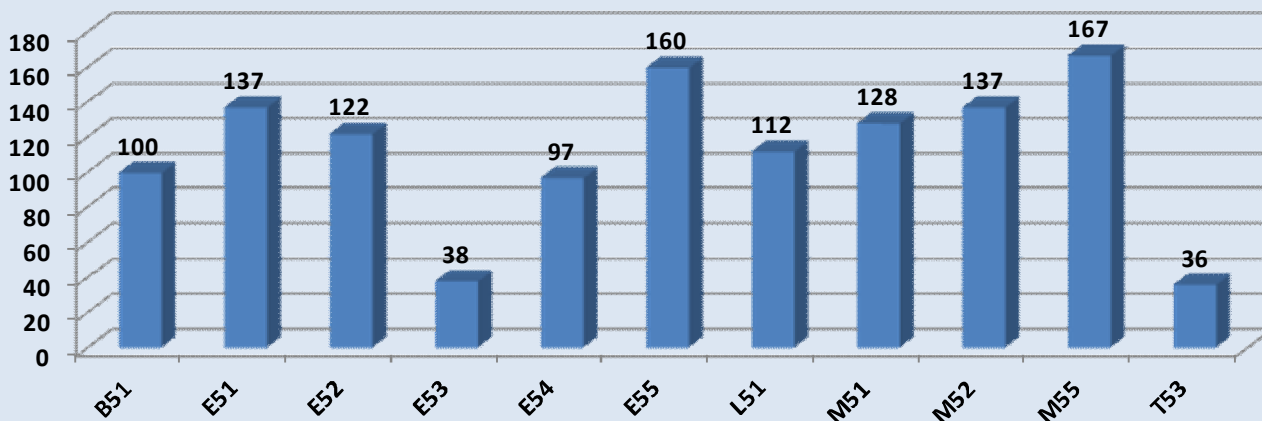


TYPE OF ALARM

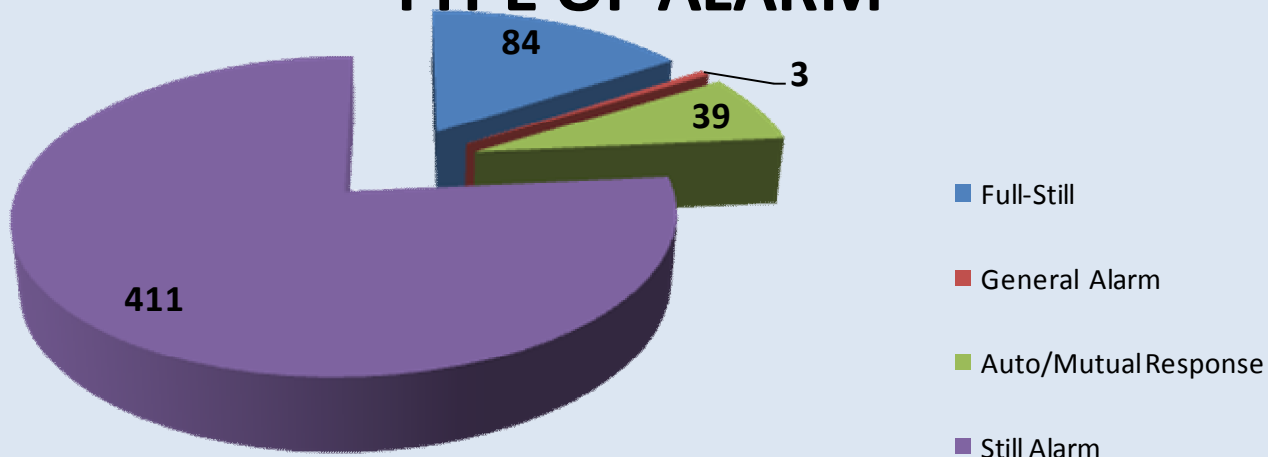


MAY 2014

HOURS BY TYPE OF LEAVE

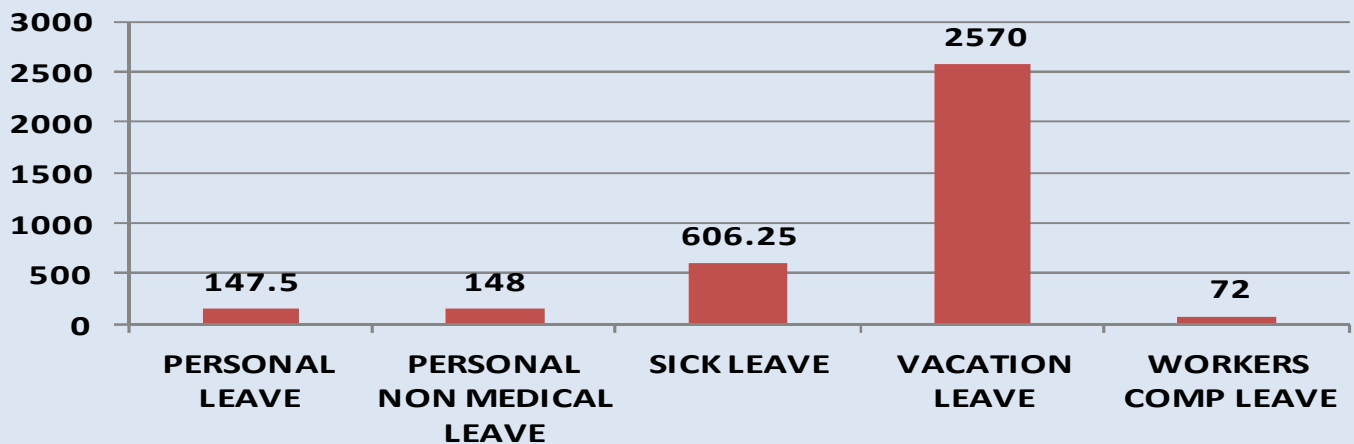

OVERTIME AND PART TIME HOURS

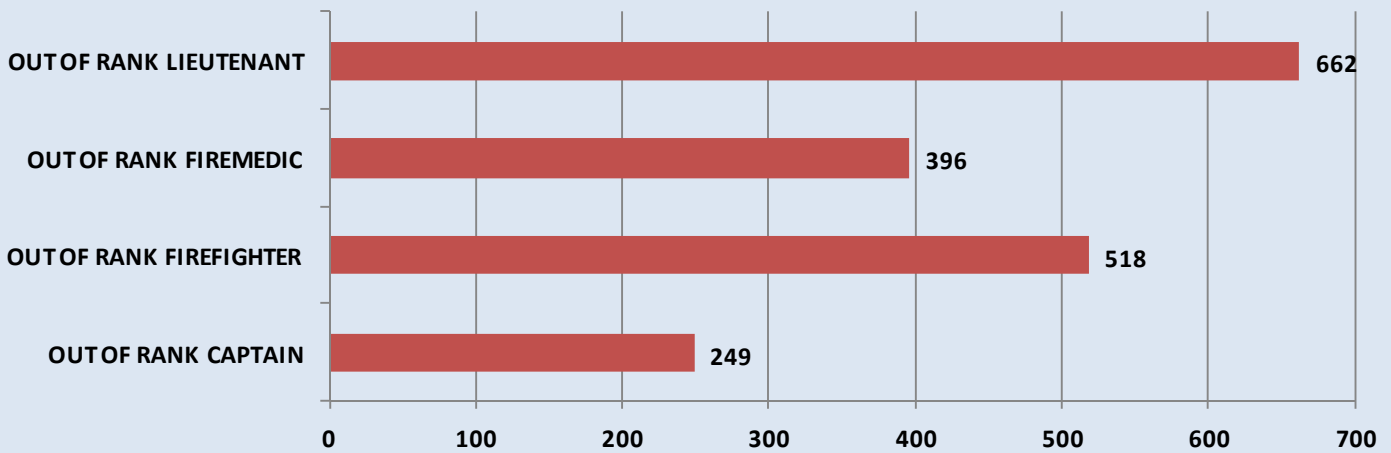

OVERTIME AND PART TIME HOURS

