



# Monthly Report

District Activity

NOVEMBER 2013

## Significant Incidents:

November 11, 2013

Structure Fire—14 Bittersweet, Woodridge

Units dispatched for a smoke investigation. While enroute alarm was upgraded to a General Alarm due to several calls indicating a building on fire. Units arrived on the scene to find flames showing from the back of the building and the interior of two units on fire. Alarm upgraded to a Box Alarm shortly after arrival. A gas meter on the back of the building was partially burned away creating a gas fed fire. Units had to wait until NICOR was able to shut down the flow of gas. Three of the four units had significant damage. Two minor firefighter injuries were reported.

## INCIDENT RESPONSE INFORMATION

**Month - 511**

**Year to date - 5817**

**Last year:**

**Month - 452**

**Year to date - 5314**

## PROPERTY / CONTENTS LOSS INFORMATION

**Month: \$406,000**

**Year to date: \$1,165,750**

### Contents Loss Information

**Month: \$102,000.00**

**Year to date: \$262,150.00**



# Monthly Report


NOVEMBER 2013

## INCIDENTS BY TYPE


Description	Incidents	Good intent call, Other	
			3
Building fire	6	Dispatched & cancelled en route	18
Cooking fire, confined to container	2	Vicinity alarm (incident in other location)	1
Passenger vehicle fire	1	Smoke scare, odor of smoke	5
Forest, woods or wildland fire	1	Steam, vapor, fog or dust thought to be smoke	2
Outside rubbish, trash or waste fire	1	False alarm or false call, Other	3
Dumpster or other outside trash receptacle fire	2	Malicious, mischievous false call, Other	1
Outside equipment fire	1	Central station, malicious false alarm	4
EMS call, excluding vehicle accident with injury	288	Local alarm system, malicious false alarm	1
MEDICAL ALERT ALARM	4	System malfunction, Other	10
Motor vehicle accident with injuries	19	Sprinkler activation due to malfunction	1
Motor Vehicle Accident with no injuries	6	Smoke detector activation due to malfunction	2
Rescue or EMS standby	2	Heat detector activation due to malfunction	1
Gasoline or other flammable liquid spill	1	Alarm system sounded due to malfunction	20
Gas leak (natural gas or LPG)	5	CO detector activation due to malfunction	2
Carbon monoxide incident	3	CO detector activation due to bad battery	1
Electrical wiring/equipment problem, Other	2	CO detector activation due to out of date/old unit	1
Heat from short circuit (wiring), defective/worn	1	Unintentional transmission of alarm, Other	1
Power line down	5	Sprinkler activation, no fire - unintentional	2
Arcing, shorted electrical equipment	2	Smoke detector activation, no fire - unintentional	10
Lock-out	5	Detector activation, no fire - unintentional	3
Water or steam leak	2	Alarm system activation, no fire - unintentional	22
Smoke or odor removal	1	Carbon monoxide detector activation, no CO	5
Animal rescue	1		
Assist police or other governmental agency	3		
Assist invalid	20		
Defective elevator, no occupants	1		
Unauthorized burning	2		
Cover assignment, standby, moveup	4		

NOVEMBER 2013


## INCIDENTS BY DISTRICT

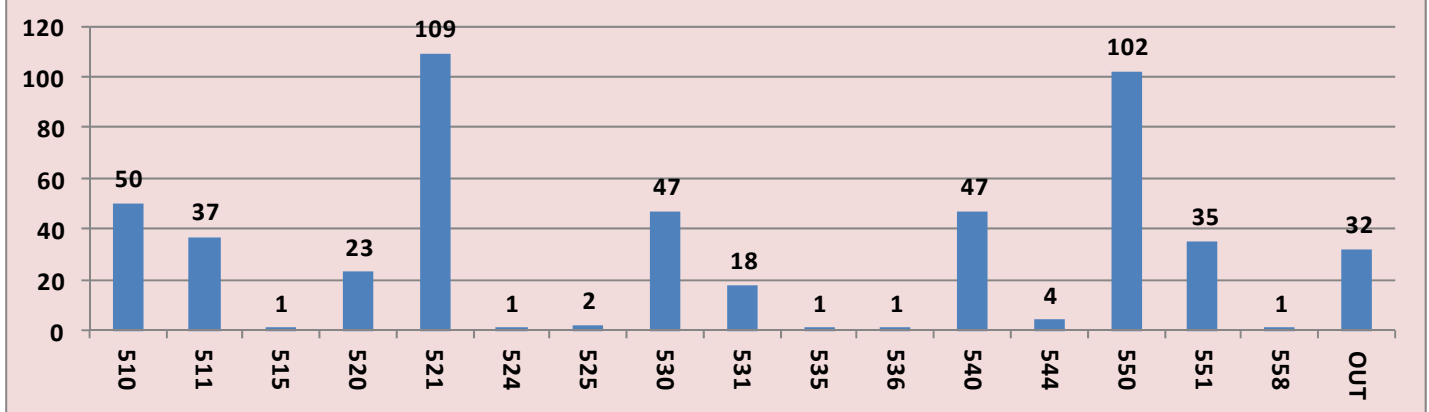

## RESPONSES BY UNIT

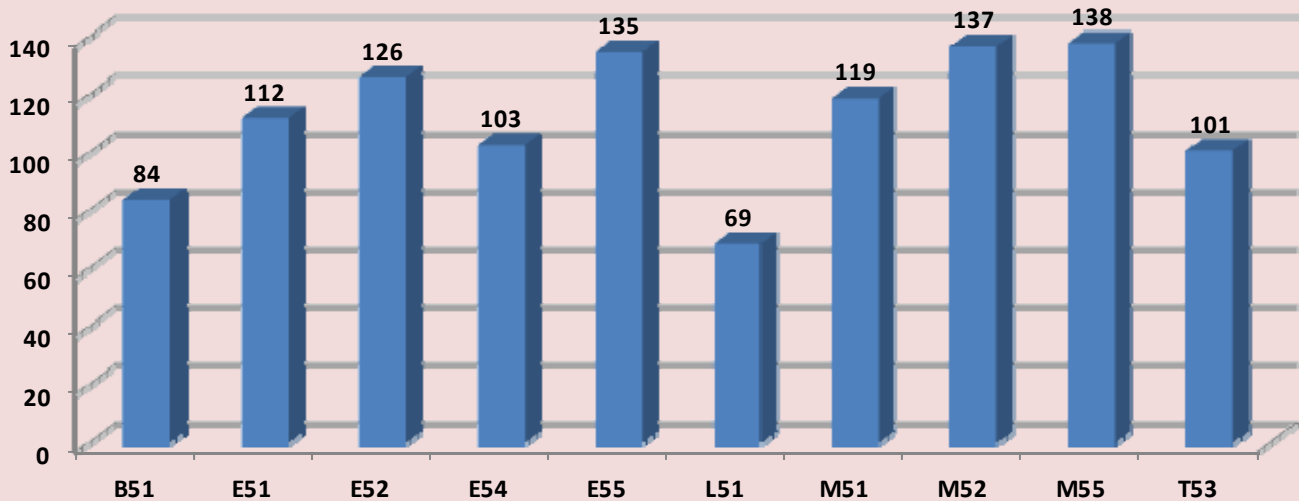

## TYPE OF ALARM REPORT

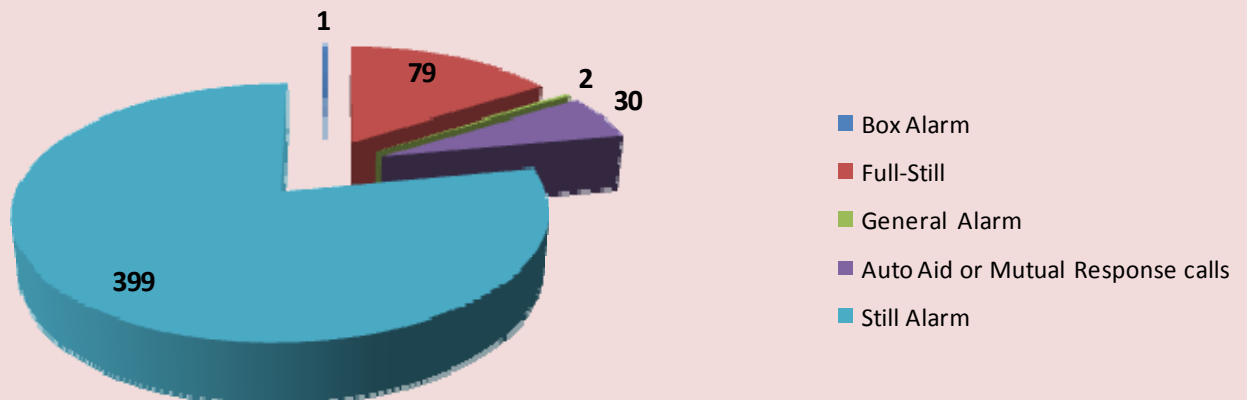

NOVEMBER 2013

