



Monthly Report

District Activity

NOVEMBER 2014

SIGNIFICANT INCIDENTS:

There were no significant or large dollar loss incidents to report for the month of November.

INCIDENT RESPONSE INFORMATION

Month - 552

Year to date - 6002

Last year:

Month - 511

Year to date - 5817

PROPERTY / CONTENTS LOSS INFORMATION

Month: \$41,000

Year to date: \$1,633,474

Contents Loss Information

Month: \$9,200

Year to date: \$509,350




Monthly Report

NOVEMBER 2014


DESCRIPTION	# Incidents	DESCRIPTION	# Incidents
Building fire	7	Assist police or other governmental agency	1
Cooking fire, confined to container	1	Assist invalid	26
Passenger vehicle fire	5	Unauthorized burning	1
Outside rubbish, trash or waste fire	1	Cover assignment, standby, moveup	2
EMS call, excluding vehicle accident with injury	309	Good intent call, Other	7
MEDICAL ALERT ALARM	6	Dispatched & cancelled en route	20
Motor vehicle accident with injuries	15	Authorized controlled burning	1
Motor vehicle/pedestrian accident (MV Ped)	4	Smoke scare, odor of smoke	2
Motor Vehicle Accident with no injuries	8	HazMat release investigation w/no HazMat	1
Removal of victim(s) from stalled elevator	9	System malfunction, Other	4
Rescue or EMS standby	5	Smoke detector activation due to malfunction	3
Gasoline or other flammable liquid spill	1	Heat detector activation due to malfunction	3
Gas leak (natural gas or LPG)	7	Alarm system sounded due to malfunction	17
Carbon monoxide incident	4	CO detector activation due to malfunction	2
Heat from short circuit (wiring), defective/worn	1	CO detector activation due to bad battery	1
Overheated motor	1	CO detector activation due to out of date/old unit	3
Arcing, shorted electrical equipment	3	Unintentional transmission of alarm, Other	5
Building or structure weakened or collapsed	1	Sprinkler activation, no fire - unintentional	2
Service Call, other	2	Smoke detector activation, no fire - unintentional	8
Lock-out	5	Detector activation, no fire - unintentional	5
Water or steam leak	2	Alarm system activation, no fire - unintentional	37
Smoke or odor removal	1	Carbon monoxide detector activation, no CO	3

NOVEMBER 2014


INCIDENTS BY DISTRICT

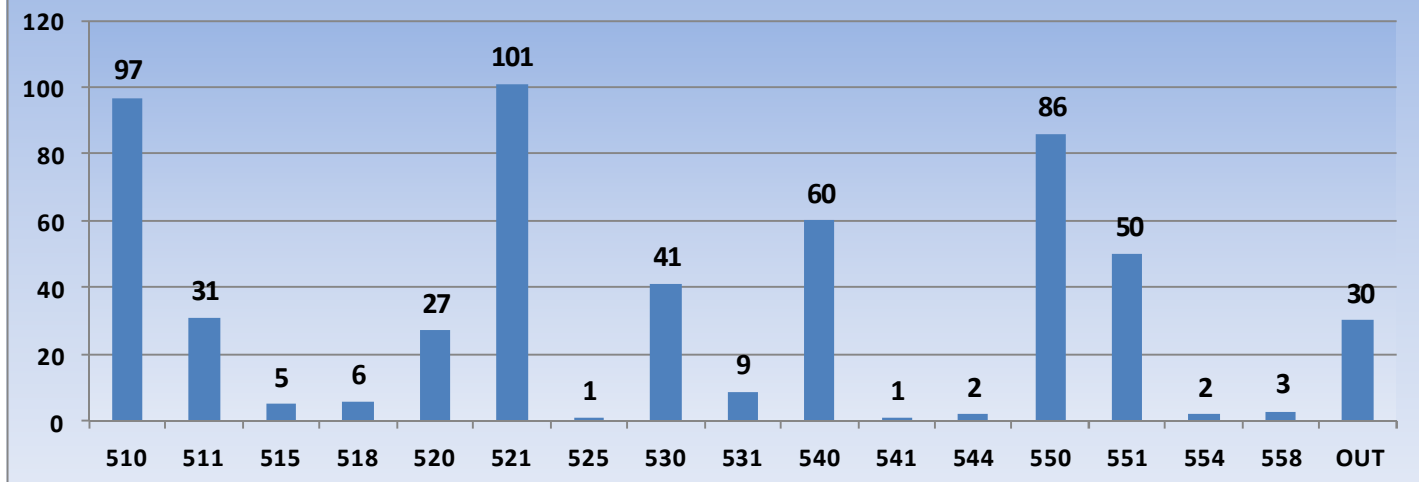

RESPONSES BY UNIT

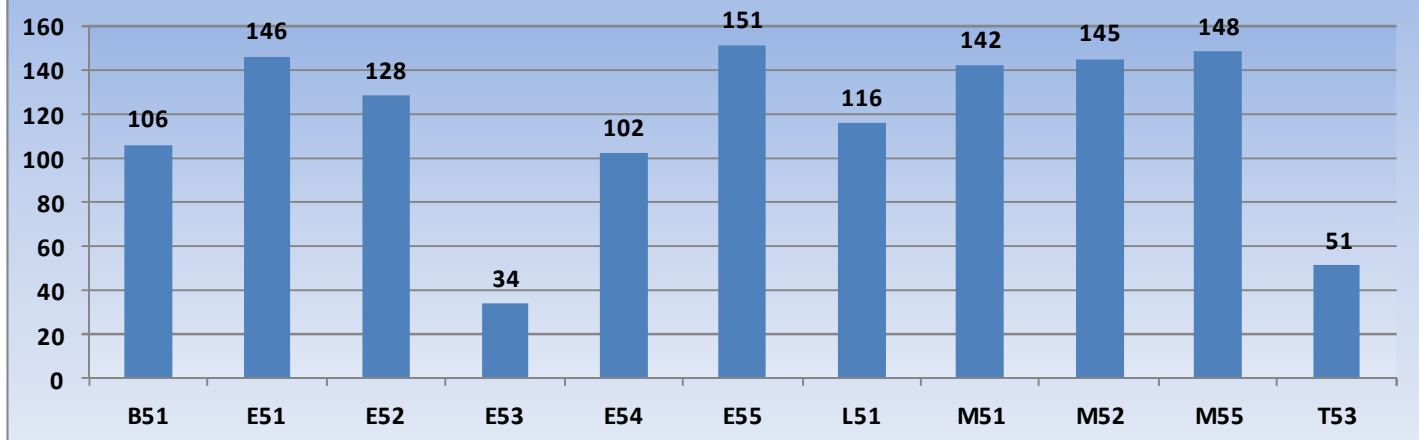

TYPE OF ALARM

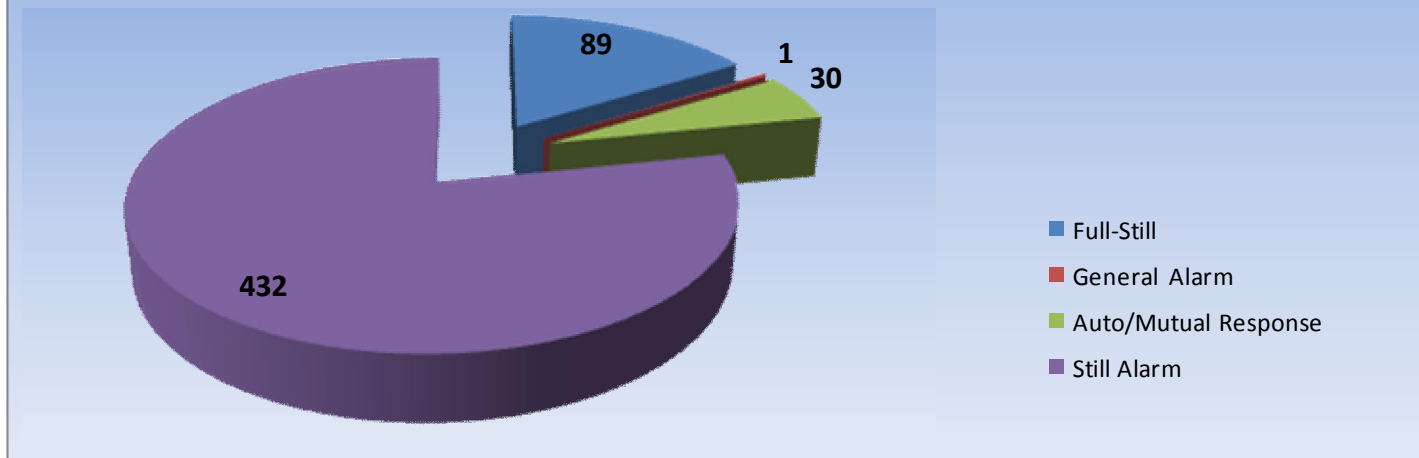

NOVEMBER 2014

